



Relay set for (N.O.) Normally Open

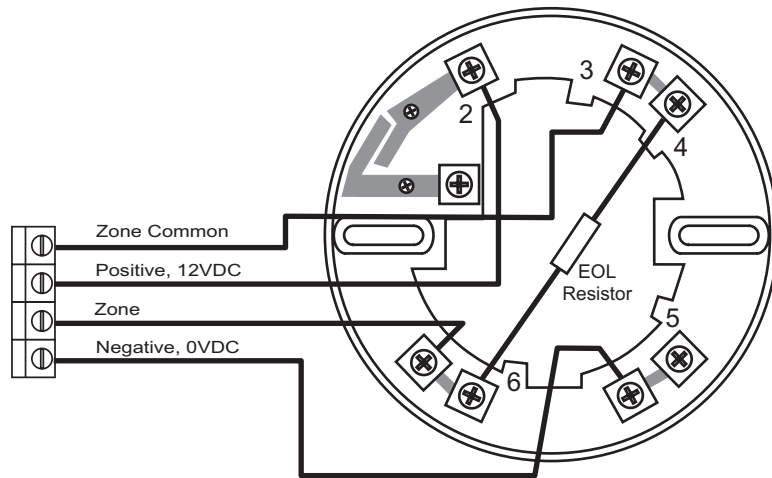


*** NOTE ***


To remove top cover remove the two screws on the back of NB-338 smoke detector

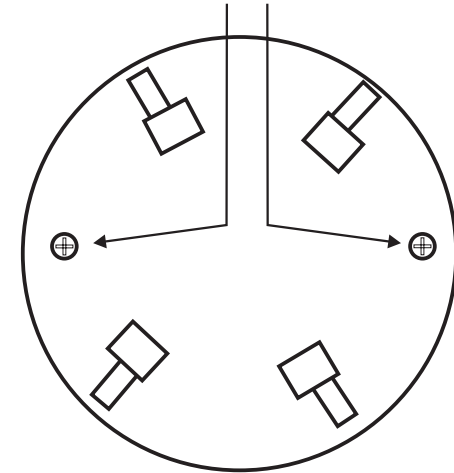

Relay set for (N.C.) Normally Closed

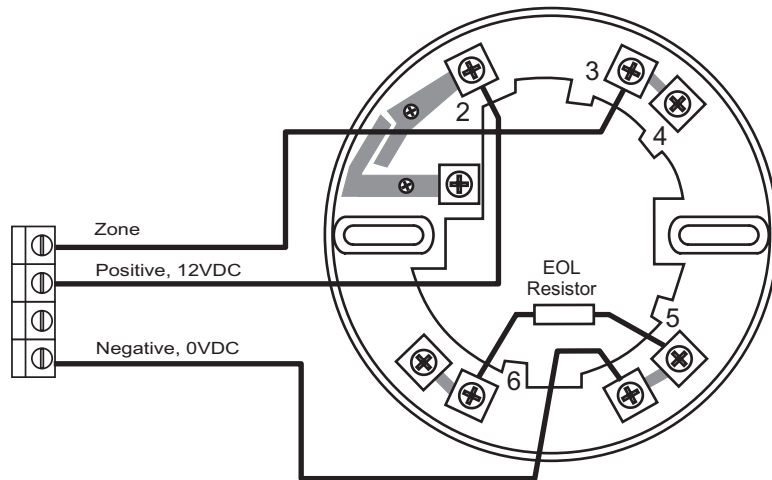

Setting Relay to Normally Closed

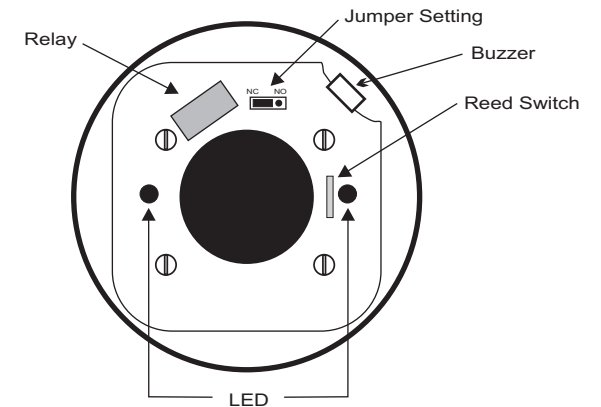


Approved by	Title Connecting NB-338 Smoke Detectors to Control Panels				
Approval date	Revision B	Scale NTS	Date 27/01/05	Sheet 1 of 1	Drawn by Victor
Product No:	Filename NB338_con.CDR				


FOR SECURITY REASONS

Always set smoke detector
to Normally Closed Option

Relay set for (N.C.) Normally Closed
Using Type 2 Single EOL Option

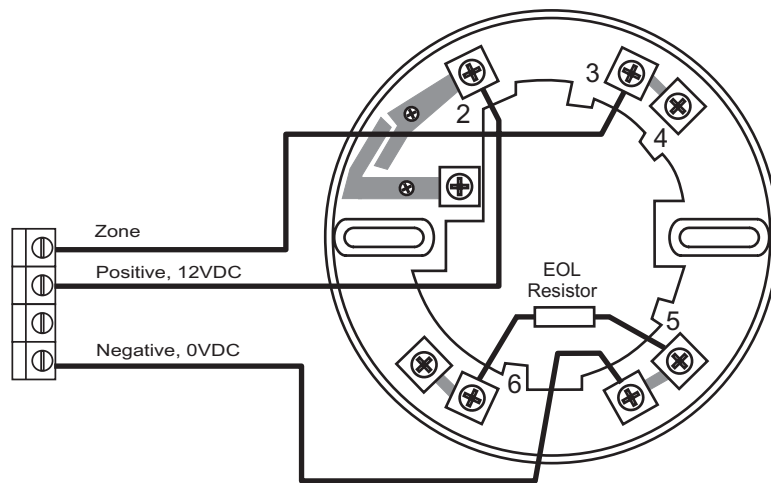

Relay set for (N.C.) Normally Closed
Using Type 4 EOL Option (2K2, 4K7, & 8K2)

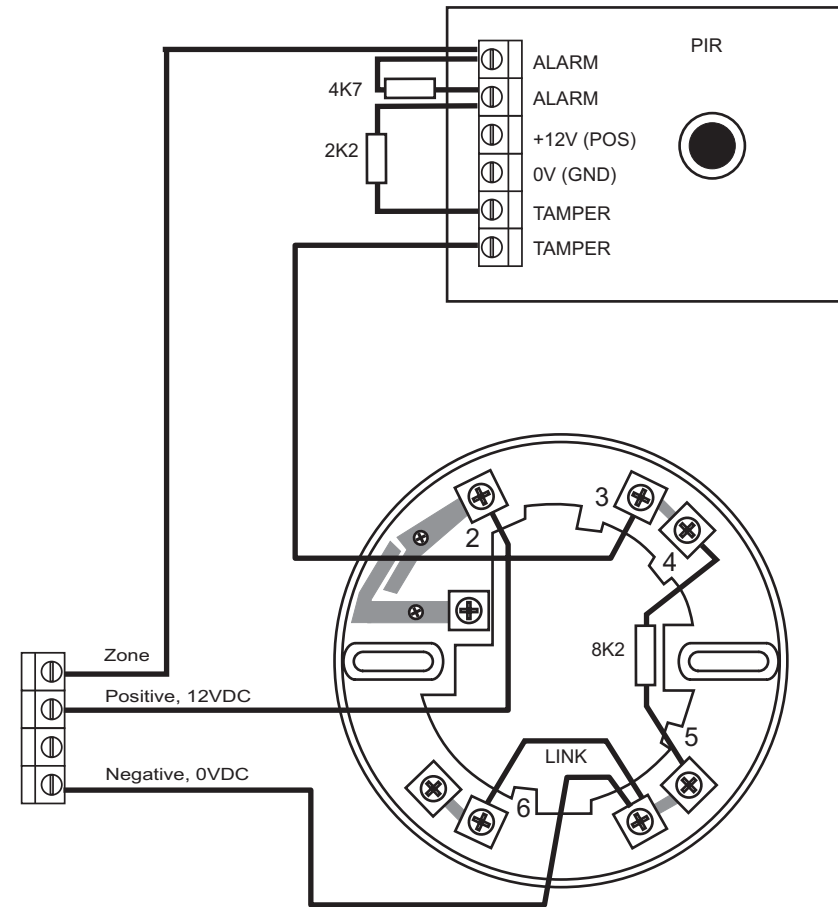

Tip:

When using Elite/Ultra/PowerWave panels and using resetting smoke models (ARB) put a entry time of 15-45 seconds on the 24Hr Zone. This will help prevent false alarms !!



Approved by	Title Connecting NB-338 Smoke Detectors to Elite Panels				
Approval date	Revision B	Scale NTS	Date 17/08/05	Sheet 1 of 1	Drawn by Victor
Product No:	Filename NB338_con.CDR				